



**TRIUMF Accident Prevention Committee
Safety Deficiency Report**

Report No.

477

From: TAPC Inspector

MARIELE GOYETTE

TRIUMF Local:

6571

To: Supervisor Names on the Bottle's TAG:

DON JACKSON (Remote HANDLING)

VICKY HANEMAYER (NUCLEAR MEDICINE)

Date Issued:

Jun 11 2013

Location:

ISAC 1 - B1 level ELECTRICAL ROOM

Inspection Area:

6

Description:

2 SIZE T COMPRESSED GAS BOTTLES TIED UP.

TO A SMALL TABLE,
(TABLE IS LOW & LIGHT)

THIS IS UNACCEPTABLE UNSAFE.

TABLE IS TOO UNSTABLE TO SUPPORT
LOAD OF GAS BOTTLES

Complete the following and return to TRIUMF Safety Group Mailbox within 48 hours

Remedial Action Taken:

CYLINDER HOLDER FRAME PURCHASED FROM
MCMMASTER CARR (ITEM 8379T11, PO# TR193029)
INSTALLED IN-SITU FEB. 2013 (SEE ATTACHED PHOTO).

Reason for No Action Taken as Yet:

Signature:

GRANT MINOR
REMOTE HANDLING

Date:

FEB 8 / 2013


Expected Date of Resolution: Day/Month/Year

For TAPC use only

Received on: Day/Month/Year _____

Reissued on: Day/ Month/Year _____

<input type="checkbox"/>	Resolved
<input type="checkbox"/>	In Progress
<input type="checkbox"/>	Outstanding

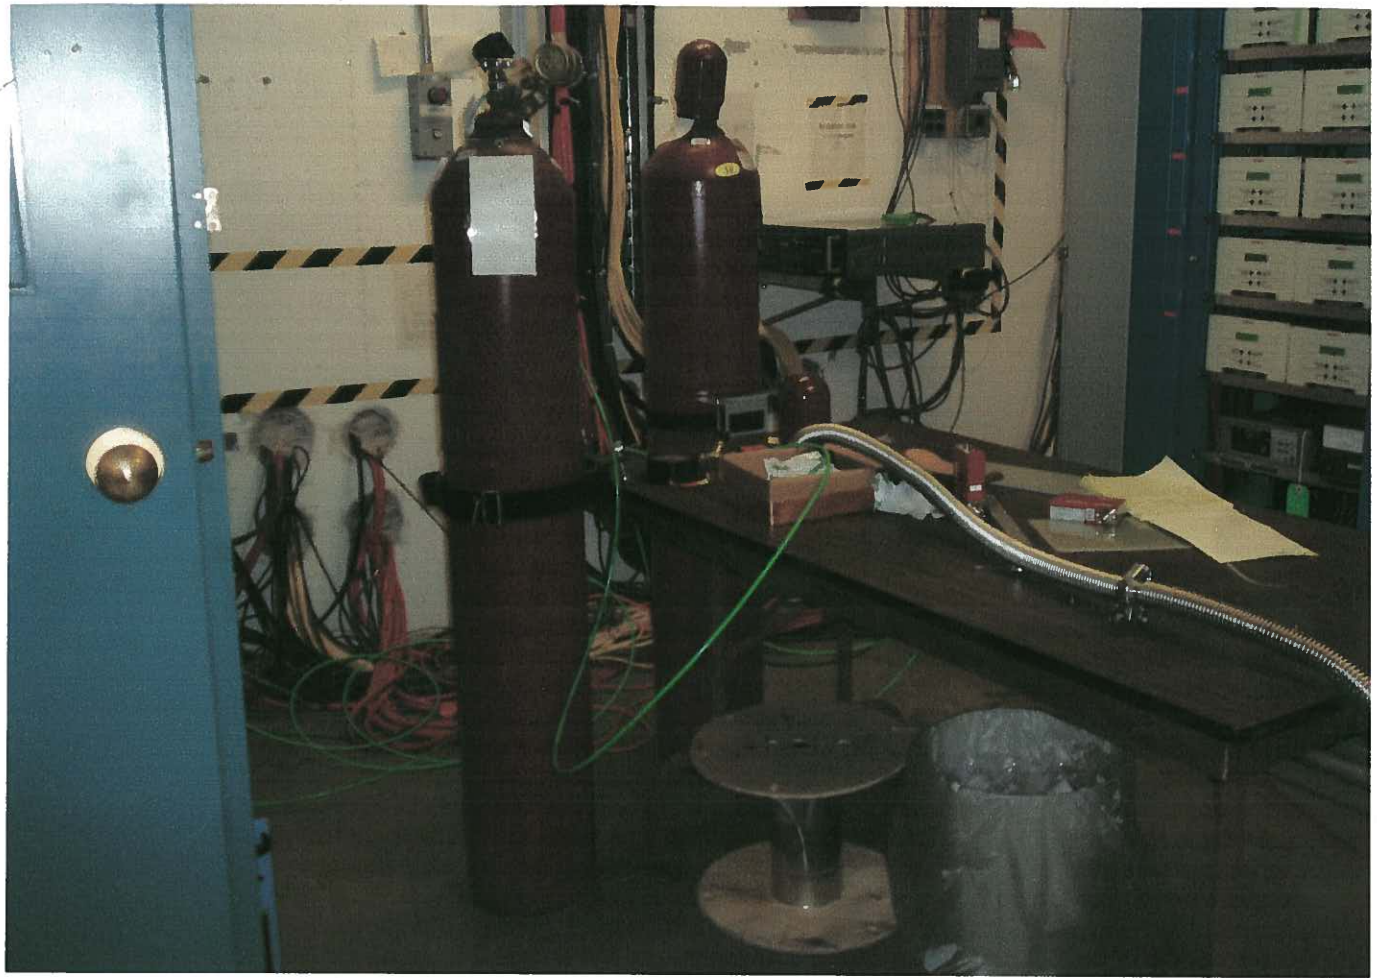

Date: Jan 11 2013

LOCATION: ISAC - B1 Level
Electrical Room.

CYLINDER
HOLDER
MCMASTER CARR
837911
PO # TR193029

8 FEB.
2013

