CRESSIBLE
ASTE

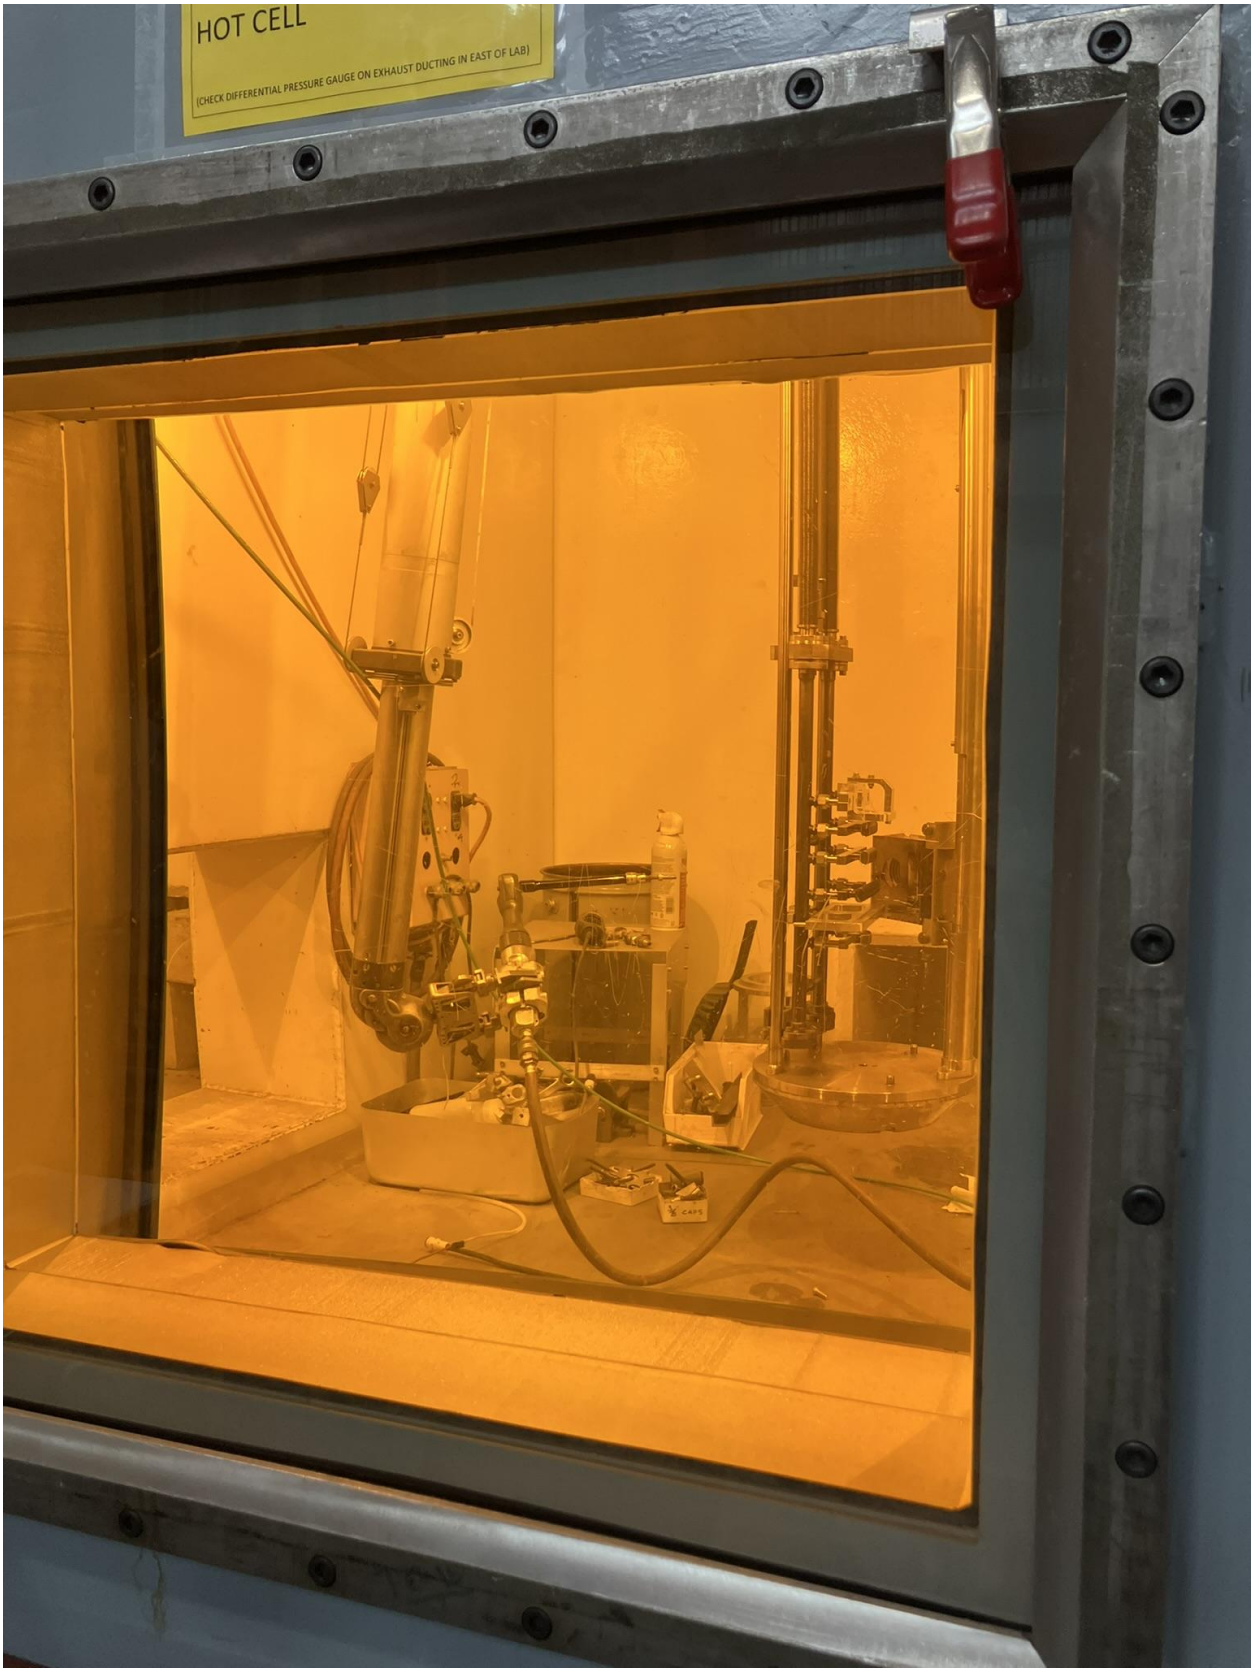
HOT CELL
(CHECK DIFFERENTIAL PRESSURE GAUGE ON EXHAUST DUCTING IN EAST OF LAB)

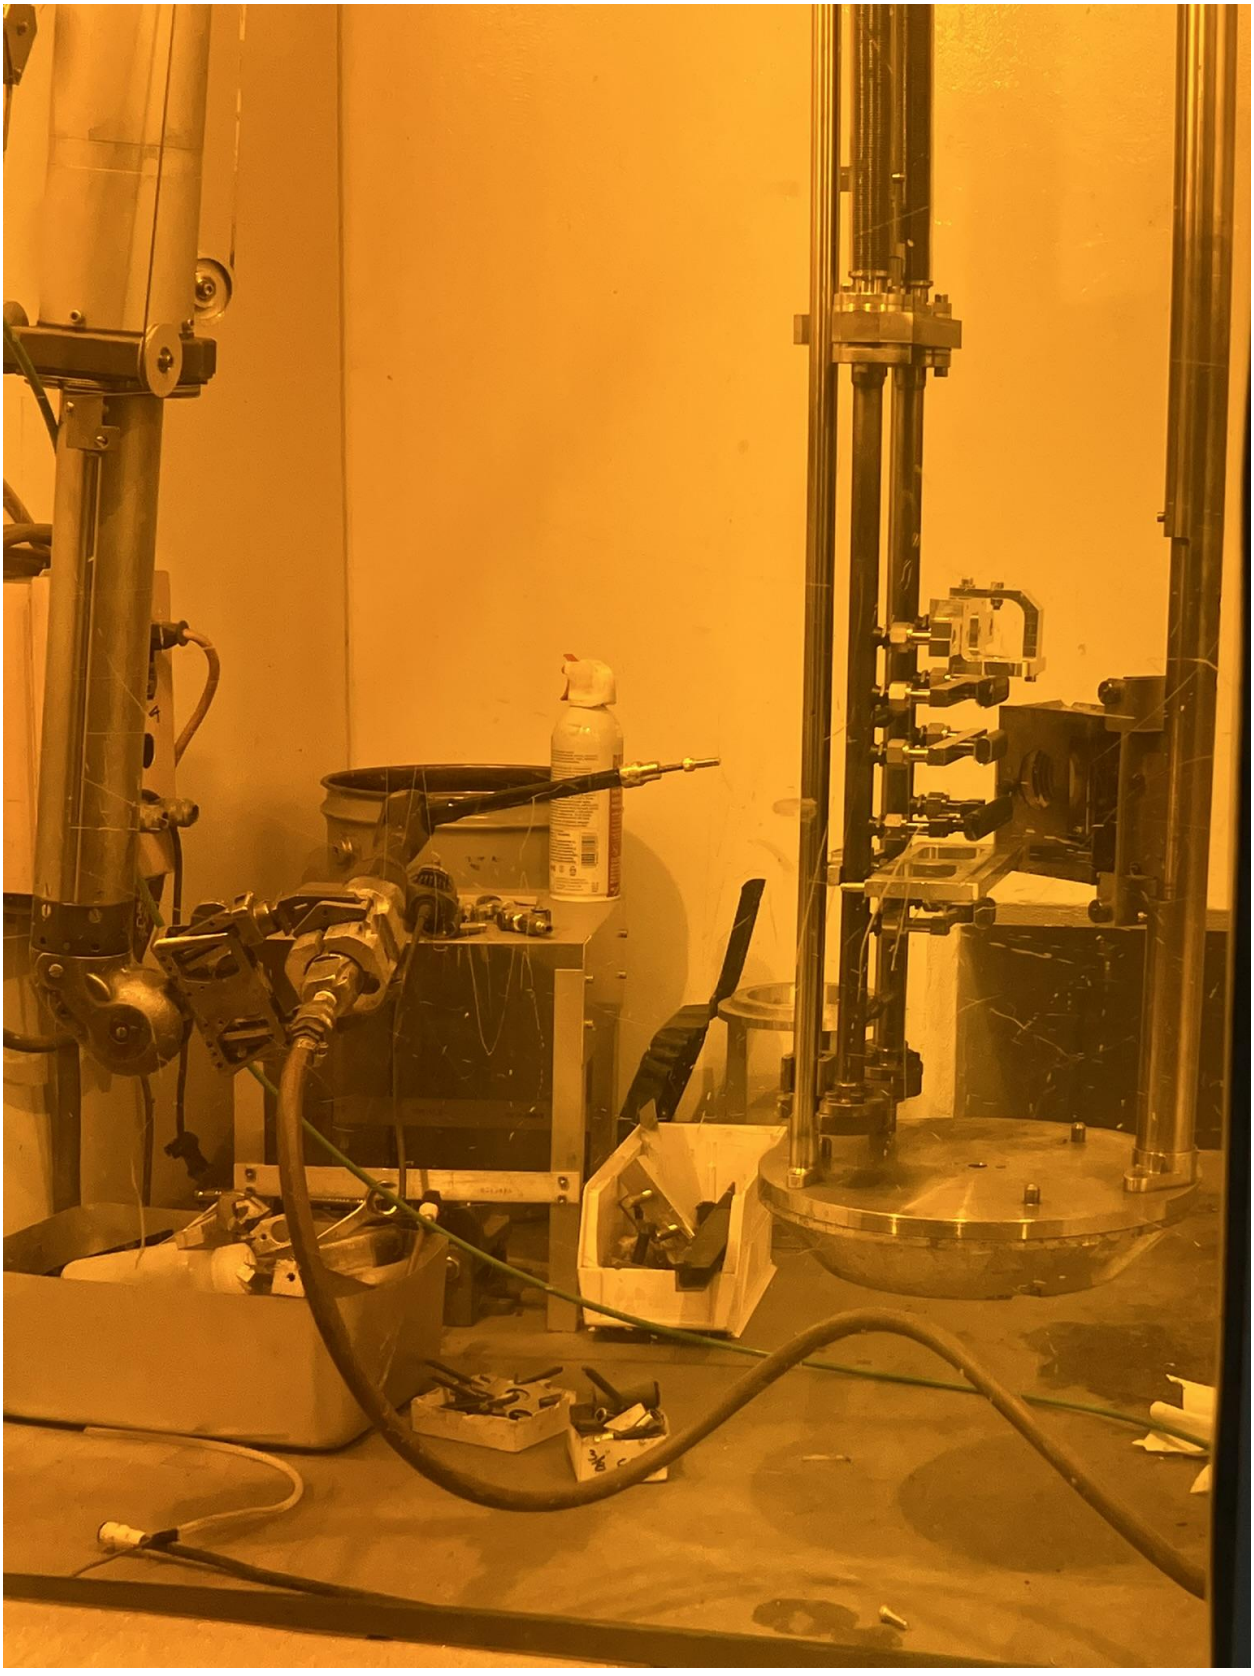

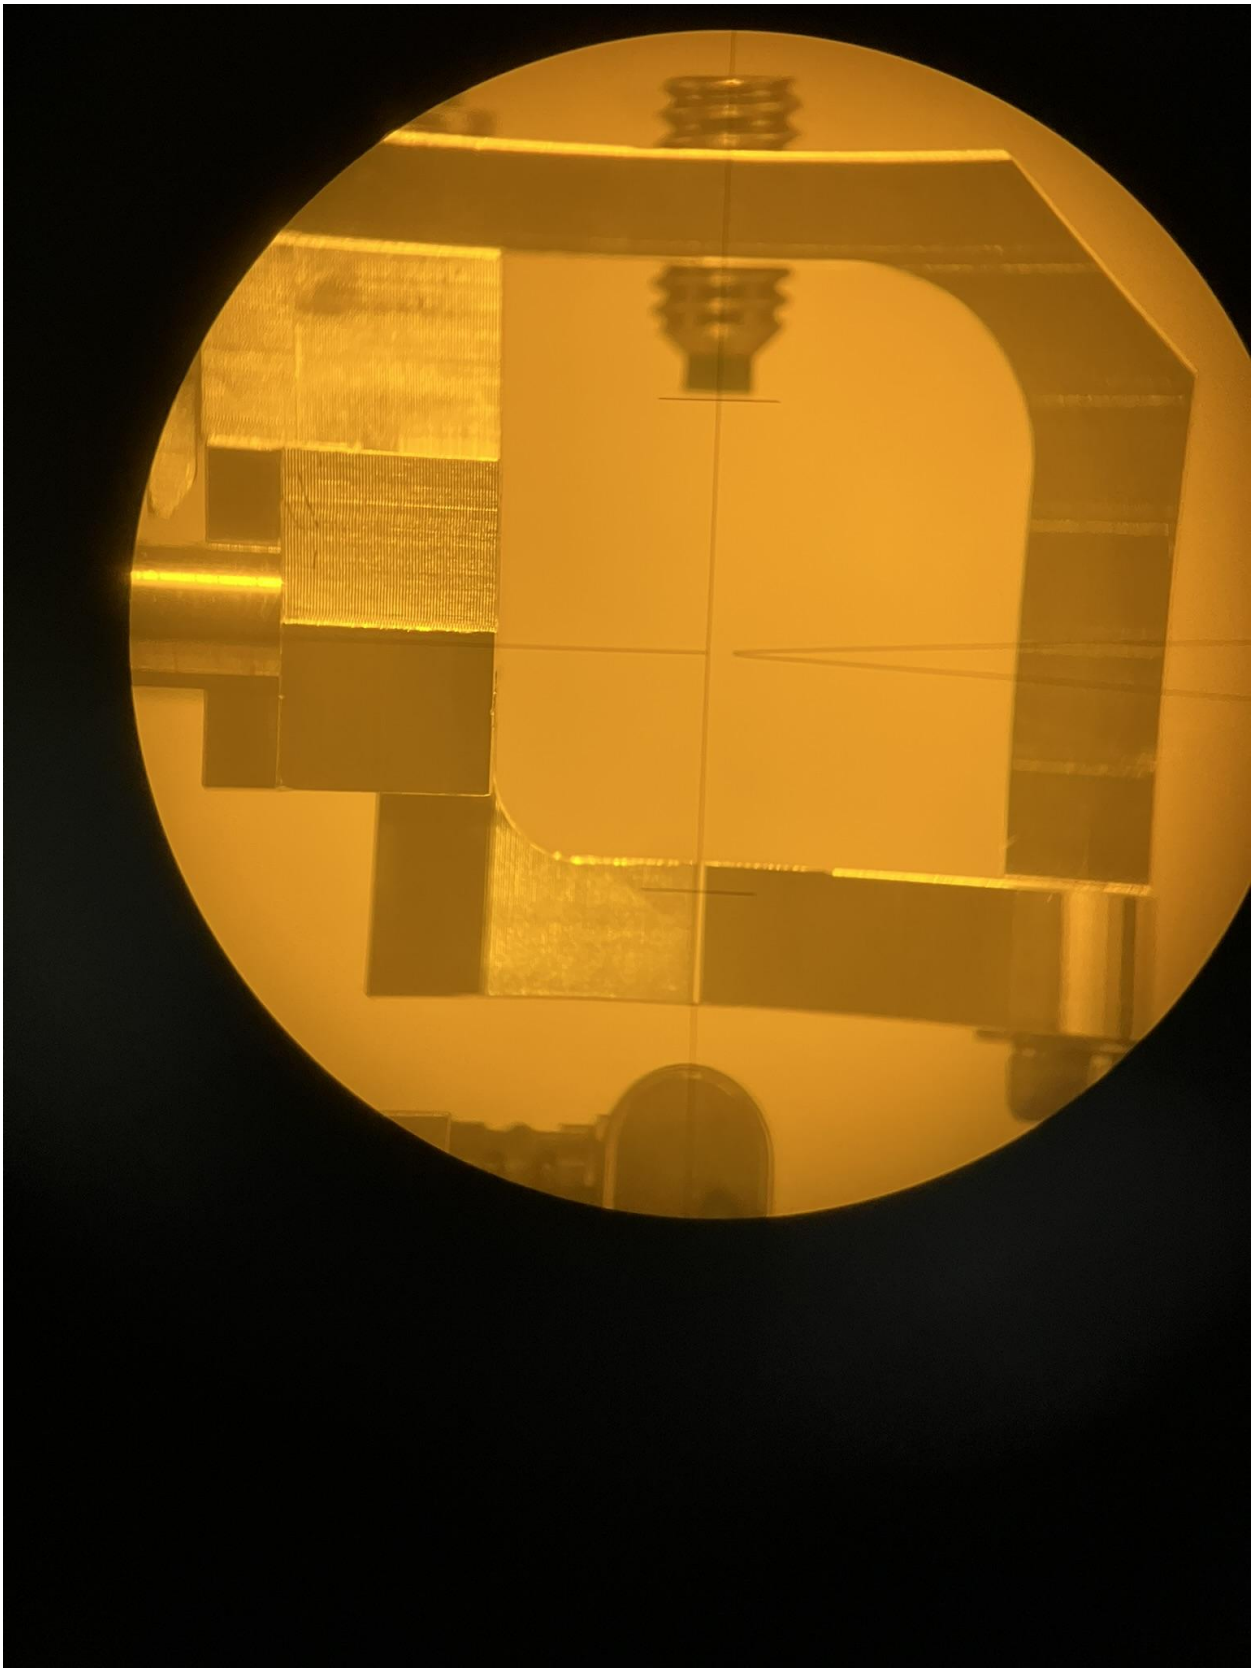

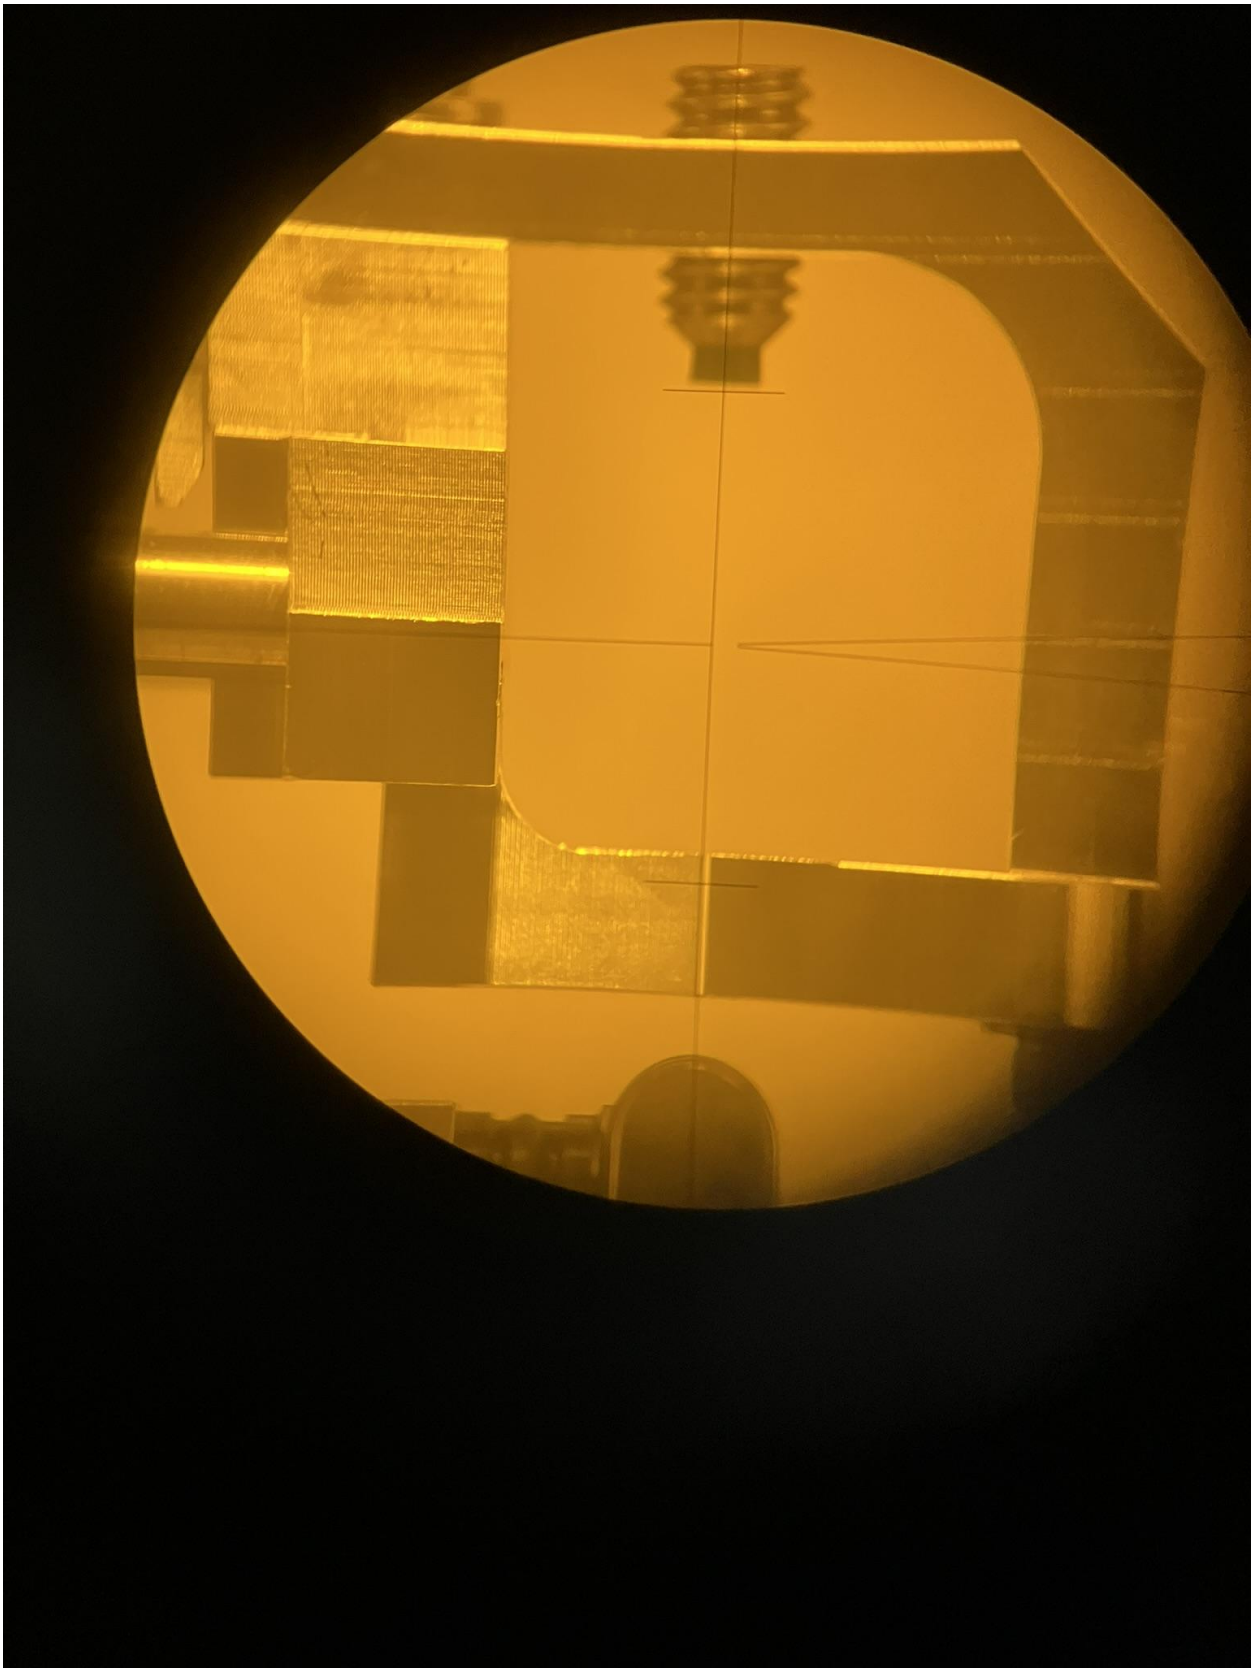

762

1762

CONFIRM VENTILATION
SYSTEM FUNCTIONING
PROPERLY BEFORE USING
HOT CELL
(CHECK DIFFERENTIAL PRESSURE GAUGE ON EXHAUST DUCTING IN EAST OF LAB)

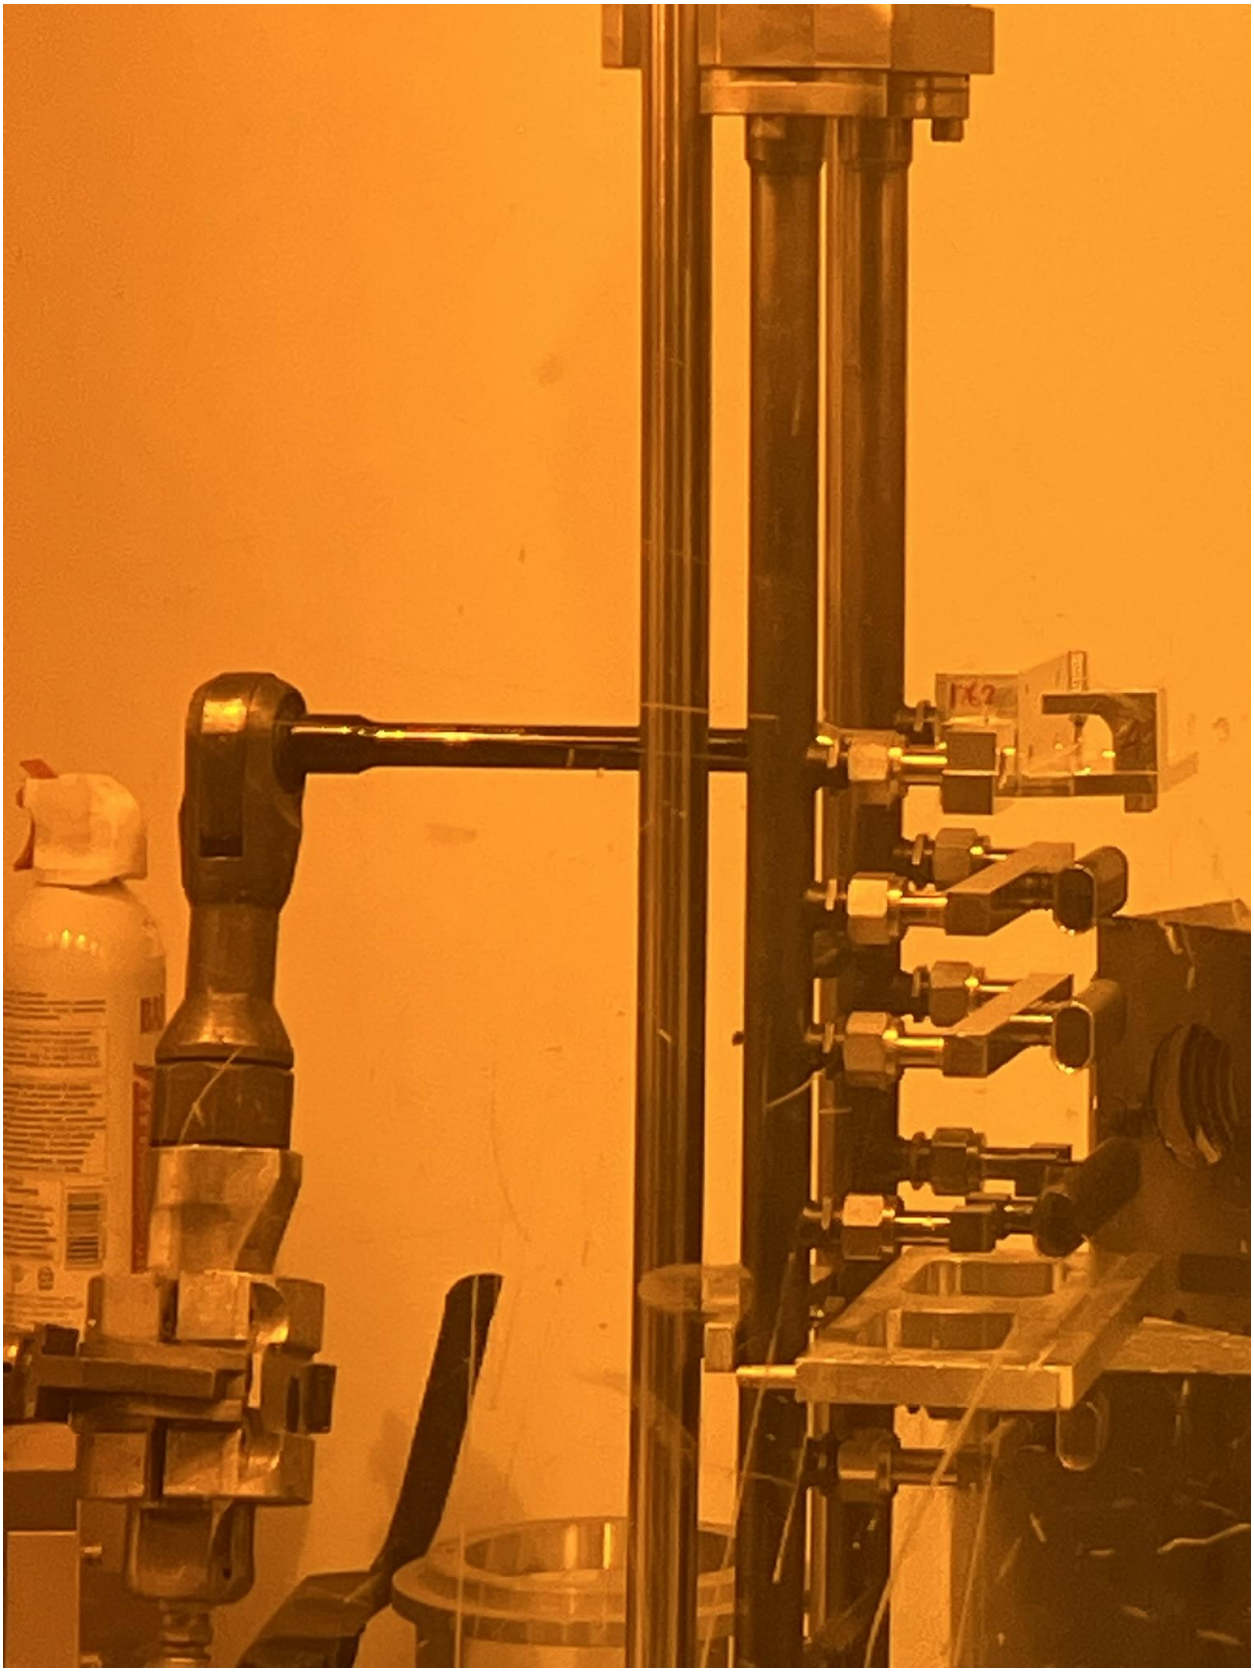

1762
A

1762
A